

UNIT B UNIT A

EAST
JUNCTION NO. 2

WEST
COKE PLANT &
COKE STORAGE SIDE

NOTE: FIRE PROTECTION - 1 1/2" HOSE
& COMBINATION SPRAY NOZZLE AT TOP
ACCESSIBLE TO ENCLOSED MAIN
WALKWAY ALONG CONVEYOR

DESIGN OF SUSPENSION BRACE
NOT BY ROBINS ENGINEERS

NOTES:

WINDOWS SHOWN IN DOTTED LINE
ARE IN FAR SIDE

WINDOWS SHOWN IN FULL LINE
ARE IN NEAR SIDE

NOTES: - DOORS SHOWN IN FULL LINE
ARE IN NEAR SIDE


DOORS SHOWN IN DOTTED LINE
ARE IN FAR SIDE

WELDED PIPE
BRACKETS, APPROX.
20'-0" ± ON CENTER,
TYP.

APPROX. 127 FT
STANDPIPE 3" SCH. 40
ASTM A 53 PIPE

2" FIRE DEPT CONNECTION
ACCESSIBLE AT BOTTOM
1 1/2" FIRE HOSE CONNECTION
AT TOP

ELEVATION

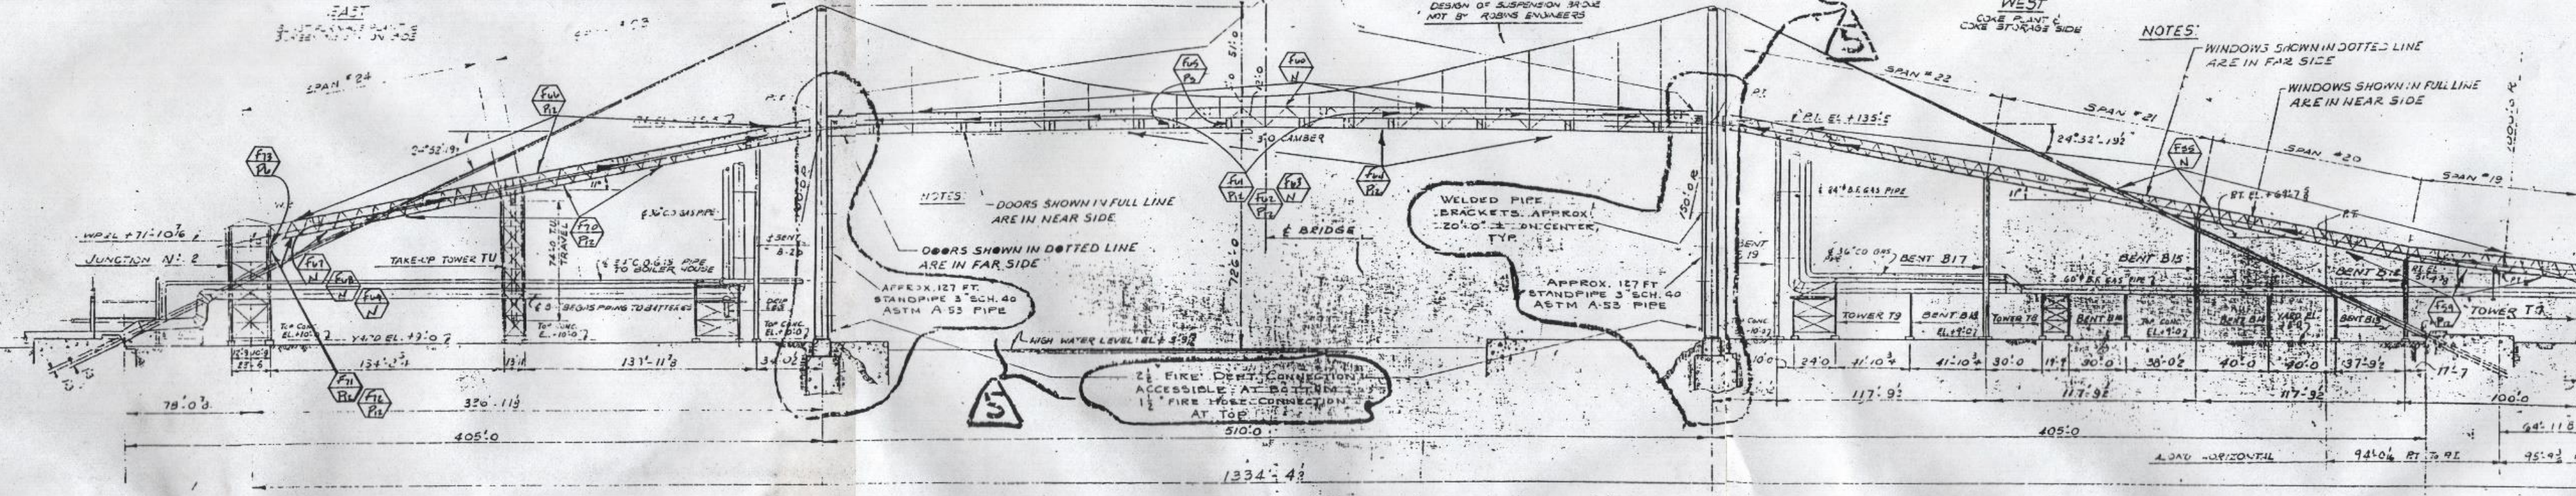

1334'-4"

LONG HORIZONTAL 94'-0 1/4" RT TO RL 95'-9 1/2" 0"